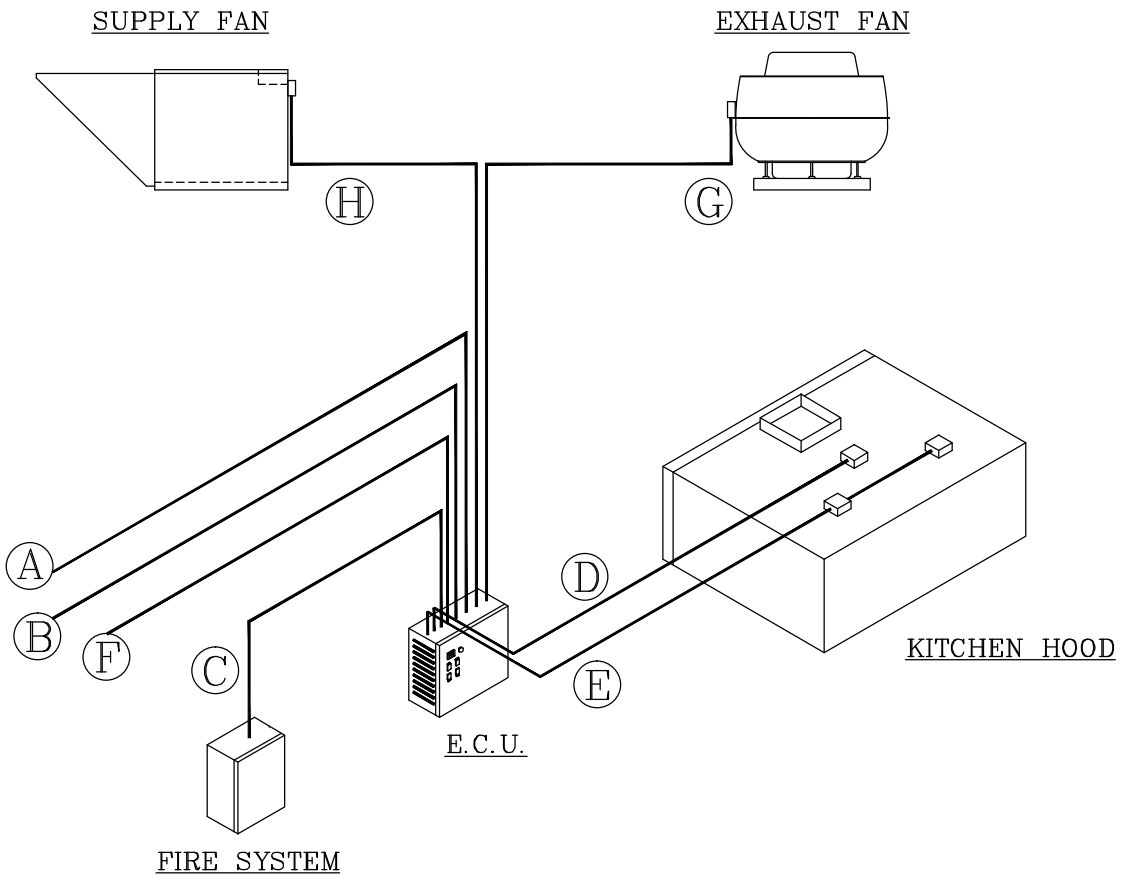

(A) 208/3/60 OR 480/3/60 MAIN ELECTRICAL SERVICE

(B) 120/1/60 SECONDARY ELECTRICAL SERVICE
(REQUIRED WITH 480/3/60 MAIN ELECTRICAL SERVICE)

(C) CONNECTION TO FIRE SYSTEM MICRO-SWITCH

(D) CONNECTION TO HOOD HEAT SENSOR

(E) ELECTRICAL SERVICE TO HOOD LIGHTS

(F) CONNECTION TO B.M.S. IF REQUIRED

(G) ELECTRICAL SERVICE FOR EXHAUST FAN
(SIGNAL CONDITIONER MAY BE REQUIRED)

(H) ELECTRICAL SERVICE FOR SUPPLY FAN
(SIGNAL CONDITIONER MAY BE REQUIRED)

ECU CONNECTION DETAIL

NO SCALE

NO.	REVISIONS	DATE	BY
5			
4			
3			
2			
1			

SELECT AIR SYSTEMS
316 W. CENTRAL AVE.
SUITE #606
WINTER HAVEN, FL. 33880
PH. (863) 294-2272
FAX (863) 294-2704

THIS DOCUMENT IS THE PROPERTY OF VMS, INC. AND IS TENDERED IN CONFIDENCE FOR THE SOLE PURPOSE OF AIDING THE TRANSACTION OF BUSINESS BETWEEN VMS, INC. AND RECIPIENT. PERMISSION IS EXPRESSLY WITHHELD TO DISCLOSE TO OTHERS THE INFORMATION CONTAINED THEREIN OR TO REPRODUCE ALL OR ANY PART OF THE DOCUMENT. THE DELIVERY OF THIS DOCUMENT BY VMS, INC. CONVEYS NO PROPERTY RIGHTS THEREIN NOR IN ANY MANNER DISCLOSED THEREIN.

PROJECT NAME:
PROJECT LOCATION:
REPRESENTATIVE:
CONTRACTOR:
ARCHITECT:
ENGINEER:
DRAWN BY: GAB DATE: 10/05/10
CHECKED BY: GAB REV.: 10/05/10
EFN: SHEET 1 OF 2 REF.NO.:

1
SHEET